


STAIRWAY ILLUMINATION: ALL EXTERIOR STAIRWAYS
SHALL BE ILLUMINATED AT THE TOP LANDING TO
THE STAIRWAY. ILLUMINATION SHALL BE CONTROLLED
FROM INSIDE THE DWELLING OR AUTOMATICALLY
ACTIVATED.

DISCLAIMER: THIS PLAN IS NOT CONSIDERED COMPLETE UNLESS
APPROVED BY YOUR LOCAL BUILDING INSPECTOR OR STRUCTURAL ENGINEER.
BUILDER ACCEPTS ALL RESPONSIBILITY AND LIABILITY.
DECKS.COM LLC, AND ASSOCIATED SPONSORS
ACCEPT NO LIABILITY FOR THE USE OF THIS PLAN.



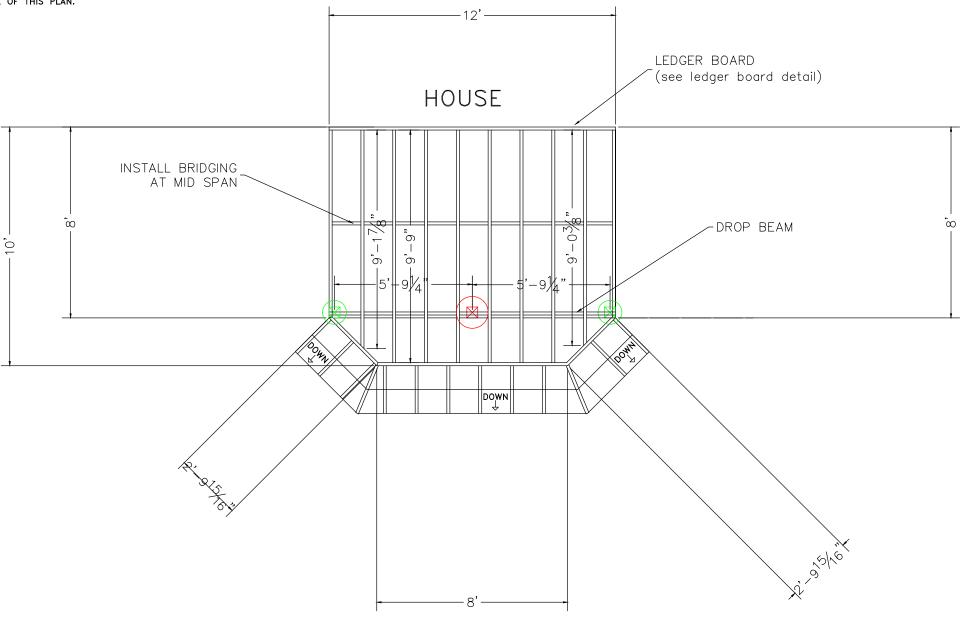

12" DIAMETER FOOTING



16" DIAMETER FOOTING



22" DIAMETER FOOTING

FOOTINGS TO BE INSTALLED
TO PROPER DEPTH AS IS
REQUIRED BY YOUR LOCAL
BUILDING ORDINANCE
FROST FOOTINGS SIZES BASED
ON 55 LB PER SQUARE FOOT
TRIBUTARY LOADS APPLIED TO

TRIBUTARY LOADS APPLIED TO 1500 PSI SOIL COMPRESSION CAPACITY (ASSUMED CLAY SOIL)

SEE FOOTING DETAIL IN DECK CONSTRUCTION GUIDE.

DISCLAIMER: ONLY USE #2 OR BETTER PRESSURE TREATED

SOUTHERN YELLOW PINE 2 x 10 FOR FRAMING MATERIALS

NEVER SUBSTITUTE COMPOSITE OR SOFTWOODS FOR FRAMING MATERIALS



PLAN

DECK

VIEW

PLAN

 \sim

DECK PLAN 1LV1210

FOOTING LAYOUT

2





THIS IS A TRIANGULATION REFERENCE POINT MEASURE TO THE CENTER OF YOUR FOOTINGS FROM THESE POINTS.

DISCLAIMER: USE ONLY 2,500 PSI CONCRETE

FOR FROST FOOTING FOUNDATIONS