
STAIRWAY ILLUMINATION: ALL EXTERIOR STAIRWAYS
SHALL BE ILLUMINATED AT THE TOP LANDING TO
THE STAIRWAY. ILLUMINATION SHALL BE CONTROLLED
FROM INSIDE THE DWELLING OR AUTOMATICALLY
ACTIVATED.

DISCLAIMER: THIS PLAN IS NOT CONSIDERED COMPLETE UNLESS APPROVED BY YOUR LOCAL BUILDING INSPECTOR OR STRUCTURAL ENGINEER. BUILDER ACCEPTS ALL RESPONSIBILITY AND LIABILITY. DECKS.COM LLC, AND ASSOCIATED SPONSORS ACCEPT NO LIABILITY FOR THE USE OF THIS PLAN.

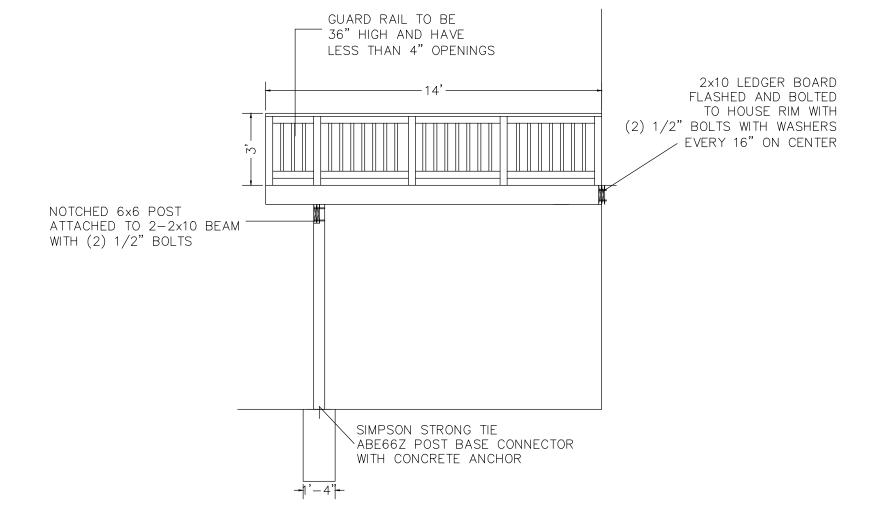

ROARD TO BE FLASHED AND BOLTED (2) 1/2" BOLTS WITH WASHERS OR EQUIVALENT FASTENERS

EDGER DETAIL IN DECK CONSTRUCTION GUIDE)

TO BE 2×10 SOUTHERN YELLOW PINE TREATED 16" ON CENTER

TO BE 2-2x10 SOUTHERN YELLOW PINE TREATED NAILED

TO BE 36" HIGH WITH LESS THAN 4" OPENINGS PER IRC CODE (see rail detail)

1LQ2614

PLAN

DECK

ELEVATION

SIDE

12" DIAMETER FOOTING

16" DIAMETER FOOTING

FROST FOOTINGS SIZES BASED ON 55 LB PER SQUARE FOOT TRIBUTARY LOADS APPLIED TO 1500 PSI SOIL COMPRESSION CAPACITY (ASSUMED CLAY SOIL)

BUILDING ORDINANCE

FOOTINGS TO BE INSTALLED TO PROPER DEPTH AS IS REQUIRED BY YOUR LOCAL

22" DIAMETER FOOTING

SEE FOOTING DETAIL IN DECK CONSTRUCTION GUIDE.

DISCLAIMER: ONLY USE #2 OR BETTER PRESSURE TREATED

SOUTHERN YELLOW PINE 2 x 10 FOR FRAMING MATERIALS

NEVER SUBSTITUTE COMPOSITE OR SOFTWOODS FOR FRAMING MATERIALS

ဥ