
STAIRWAY ILLUMINATION: ALL EXTERIOR STAIRWAYS
SHALL BE ILLUMINATED AT THE TOP LANDING TO
THE STAIRWAY. ILLUMINATION SHALL BE CONTROLLED
FROM INSIDE THE DWELLING OR AUTOMATICALLY
ACTIVATED.

DISCLAIMER: THIS PLAN IS NOT CONSIDERED COMPLETE UNLESS APPROVED BY YOUR LOCAL BUILDING INSPECTOR OR STRUCTURAL ENGINEER. BUILDER ACCEPTS ALL RESPONSIBILITY AND LIABILITY. DECKS.COM LLC, AND ASSOCIATED SPONSORS ACCEPT NO LIABILITY FOR THE USE OF THIS PLAN.

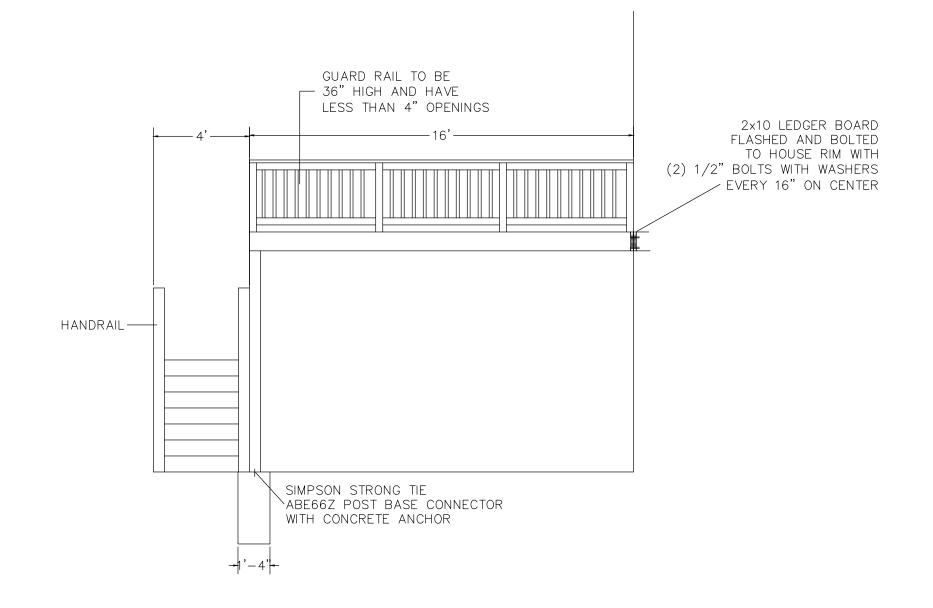

LEDGER BOARD TO BE FLASHED AND BOLTED (2) 1/2" BOLTS WITH WASHERS OR EQUIVALENT FASTENERS (SEE LEDGER DETAIL IN DECK CONSTRUCTION GUIDE)
JOISTS TO BE 2x10 SOUTHERN YELLOW PINE TREATED 16" ON CENTER
BEAMS TO BE 2-2x10 SOUTHERN YELLOW PINE TREATED NAILED
RAILS TO BE 36" HIGH WITH LESS THAN 4" OPENINGS PER IRC CODE (see rail detail)
STAIRS TO BE BUILT MAX RISE 7 3/4" MIN RISE 4" MIN RUN 10" PER IRC CODE (see detail)

TO BE

9

1LR2

PLAN

DECK

ELEVATION

SIDE

4

12" DIAMETER FOOTING

16" DIAMETER FOOTING

OTING FROST FOOTINGS SIZES BASED
ON 55 LB PER SQUARE FOOT
TRIBUTARY LOADS APPLIED TO
1500 PSI SOIL COMPRESSION
CAPACITY (ASSUMED CLAY SOIL)

22" DIAMETER FOOTING

SEE FOOTING DETAIL IN DECK CONSTRUCTION GUIDE.

FOOTINGS TO BE INSTALLED TO PROPER DEPTH AS IS REQUIRED BY YOUR LOCAL

BUILDING ORDINANCE

DISCLAIMER: ONLY USE #2 OR BETTER PRESSURE TREATED

SOUTHERN YELLOW PINE 2 x 10 FOR FRAMING MATERIALS

NEVER SUBSTITUTE COMPOSITE OR SOFTWOODS FOR FRAMING MATERIALS