
STAIRWAY ILLUMINATION: ALL EXTERIOR STAIRWAYS
SHALL BE ILLUMINATED AT THE TOP LANDING TO
THE STAIRWAY. ILLUMINATION SHALL BE CONTROLLED
FROM INSIDE THE DWELLING OR AUTOMATICALLY
ACTIVATED.

DISCLAIMER: THIS PLAN IS NOT CONSIDERED COMPLETE UNLESS APPROVED BY YOUR LOCAL BUILDING INSPECTOR OR STRUCTURAL ENGINEER. BUILDER ACCEPTS ALL RESPONSIBILITY AND LIABILITY. DECKS.COM LLC, AND ASSOCIATED SPONSORS ACCEPT NO LIABILITY FOR THE USE OF THIS PLAN.

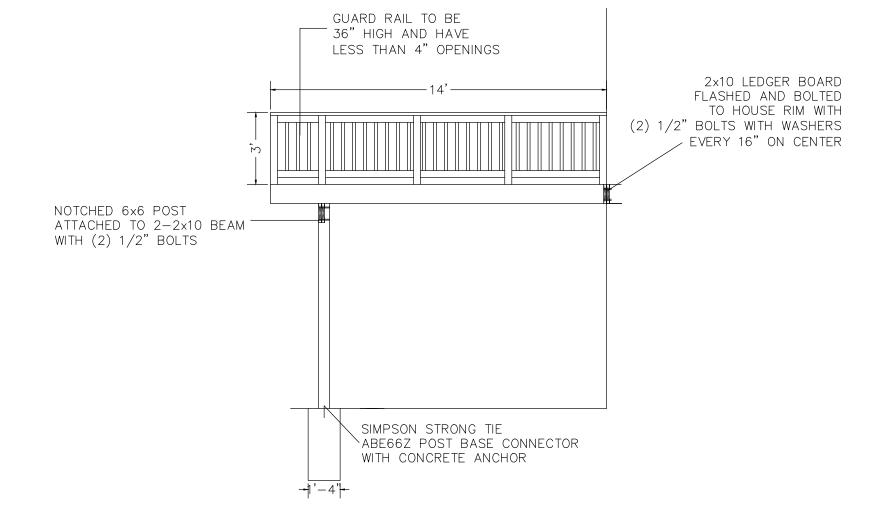

ENT FASTENERS _____

ELEVATION

SIDE

1LQ3014

PLAN

DECK

(SEE LEDGER DETAIL IN DECK CONSTRUCTION GUIDE)
JOISTS TO BE 2×10 SOUTHERN YELLOW PINE TREATED 16" ON CENTER
BEAMS TO BE 2-2×10 SOUTHERN YELLOW PINE TREATED NAILED
RAILS TO BE 36" HIGH WITH LESS THAN 4" OPENINGS PER IRC CODE (see rail detail)
STAIRS TO BE BUILT MAX RISE 7 3/4" MIN RISE 4" MIN RUN 10" PER IRC CODE (see detail)

ဥ

12" DIAMETER FOOTING

16" DIAMETER FOOTING

FROST FOOTINGS SIZES BASED ON 55 LB PER SQUARE FOOT TRIBUTARY LOADS APPLIED TO 1500 PSI SOIL COMPRESSION CAPACITY (ASSUMED CLAY SOIL)

FOOTINGS TO BE INSTALLED

TO PROPER DEPTH AS IS REQUIRED BY YOUR LOCAL BUILDING ORDINANCE

22" DIAMETER FOOTING

SEE FOOTING DETAIL IN DECK CONSTRUCTION GUIDE.

DISCLAIMER: ONLY USE #2 OR BETTER PRESSURE TREATED

SOUTHERN YELLOW PINE 2 x 10 FOR FRAMING MATERIALS

NEVER SUBSTITUTE COMPOSITE OR SOFTWOODS FOR FRAMING MATERIALS